

इंडियन बैंक



Indian Bank

इलाहाबाद

ALLAHABAD

ZONAL Office, Lucknow, 2nd Floor,
New Building, Hazratganj,
Lucknow-226001

TENDER DOCUMENT

AIR CONDITIONING SYSTEM ALONGWITH ASSOCIATED ACCESSORIES FOR INDIAN BANK
PREMISES AT IN EXISTING PREMISES OF
INDIAN BANK-K.G.M.C., DISTRICT-LUCKNOW

PART-II FINANCIAL BID

Ref. No:

Date :

Name of the contractor:

.....
.....
.....

Last date of submission of tenders	08.12.2025 up to 15.00Hrs. at Indian Bank, ZONAL Office, Lucknow, 2nd Floor, New Building, Hazaratganj, Lucknow-226001
Date of opening Tender	08.12.2025 upto 15.30 Hrs. at Indian Bank, ZONAL Office, Lucknow, 2nd Floor, New Building, Hazaratganj, Lucknow-226001
Cost Of Tender	Free Of Cost.

This part of the tender should be submitted in a separate envelope and financial bid shall be quoted only in this form and no other form will be accepted.

**DETAILED SPECIFICATION FOR BILL OF QUANTITIES OF AIR-CONDITIONING WORK FOR
INDIAN BANK BRANCH K.G.M.C.**

S.NO.	DESCRIPTION OF ITEM	QUANTITY	UNIT	RATE (Rs.)	AMOUNT (Rs.)
B.	AIR - CONDITIONING WORKS.				
	PART I -HIGH SIDE WORK				
1	Supplying, erection, testing and commissioning following wall mounted Split/ Roof mounted cassette units of (Toshiba/ Mitsubishi/ Hitachi/ Daikin/LG/Blue star/ Carrier/ Voltas) with cordless remote complete with all necessary fittings duly insulated with 9 mm thick nitrile rubber pipe insulation with (evaporator coil – copper only), fan and fan motor, machine control panel improved Refrigerant Joints, Air conditioners shall be fitted with hermetically sealed type suction cooled reciprocating or discharge cooled rotary compressor or scroll compressor. Compressor unit operating on R-22/ R-410. All complete as per drawing, approval and instructions of the Employer (Rates to be inclusive of Copper refrigerant pipe with insulation and Drain pipe up to 5 Mtr. length).				
a	1.0 TR wall mounted split unit (Minimum 5-Star rating inverter type) including all necessary fittings and mountings as specified by the manufacturer.	Nos.	0		
b	1.5 TR wall mounted split unit (Minimum 5-Star rating inverter type) including all necessary fittings and mountings as specified by the manufacturer.	Nos.	2		
c	2.0 TR wall mounted split unit (Minimum 5-Star rating inverter type) including all necessary fittings and mountings as specified by the manufacturer.	Nos.	7		
	PART I -HIGH SIDE WORK SUB TOTAL AMOUNT				
	PART - II LOW SIDE WORK				
	EXTRA REFRIGERANT PIPING				
	Supplying and laying of Extra copper refrigerant piping with nitrile rubber pipe insulation both of size as specified by the manufacturer suitable for 1.0 TR/ 1.5/2.0 TR Split type AC and 2.0/3.0 TR Cassette AC (From Indoor to outdoor Units) Beyond 5 M.				
a	For 1.0 TR/ 1.5/ TR Split unit	Mtr.	15		
b	For 2.0 T Split unit	Mtr.	40		
2	DRAIN PIPING				
	Providing and fixing drain piping up to drain as directed by the engineer in charge with all accessories e.g. elbows, unions, sockets, reducers, reducing tees, nipples etc. Complete job including cutting chiseling in walls, fixing with GI clamps, floor and making good of all chases/cuts etc. and discharging the drain into a floor trap/ gully as per site conditions with insulation, both as specified by the manufacturer.				
a	25 mm dia. Heavy duty PVC drain pipe for Split AC	Mtr.	85		
3	AUTOMATIC VOLTAGE CONTROLLER				
	Stabilizer shall be Automatic version with copper coil transformer and the voltage selection range shall be minimum depending on lowest peak recorded average in a month. Precise output voltage range (130V-170V to 240V -270 V). Ensure the rating of Stabilizer shall be in accordance with max rated power of ACs considering instantaneous peak load fluctuation.				
	Providing and fixing Stabilizer with 3-4 step relay and input voltage range of 130-270 V and output to be 230- 240 V (Blue bird/ Logic state/ Inline/ V-Guard/Equivalent Reputed Make) (copper winding).				
a	5 KVA (For 3.0/ 2.0 TR Split AC)	Nos.	0		
b	4 KVA (For 1.5/ 2.0 TR Split AC)	Nos.	9		
c	3 KVA (For 1.0/ 1.5 TR Split AC)	No.	0		

4	Supply and Installation of Safety MS Grilles with 12 mm Square bar not More than 150 C/C * 200 mm C/C with locking Arrangement	Nos.	9		
5	Supply And Installation Outdoor Unit Stand	Nos.	9		
6	ELECTRICAL CABLES				
	Suitable IS/BIS standard Cable of 1.1-2.2 KV, Multi strand, FRLS 2- 4 C / 1 5/2.5 -6.0 Sqmm) as per design requirement of Peak load calculation of specific ACs system installed at site with 1"/1 1/2"/2" PVC conduit pipe between indoor/outdoor unit				
a	Supplying and laying of Extra Electrical interconnecting control cable from indoor to outdoor of size as specified by the manufacturer suitable for 1.0 TR/ 1.5/2.0 TR Split type AC.	Mtr.	195		
7	TIMER				
a	Supplying, installation and commissioning of automatic 24 HRS. programmable TIMER of required capacity to run A.C. alternately (MDS/ L&T/ Other reputed make).	Nos.	0		
8	CORE CUTTING				
a	Core cutting member in Non RCC	Nos.	9		
9	Dismantling of existing Acs and reinstalling the same after carrying out servicing, copper piping, electrical cable, stand, lifting etc.(Rates including 5m Cu pipe & refrigerant pipe)	Nos.	2		
10	Buyback Removing and buy back of the existing Window/Split ACs installed at branch including Copper line, respectiveing Cables, which are not useful for the bank as directed by bank				
i	Window Ac	Nos.	3		
ii	Split Ac	Nos.	4		
	PART II – LOW SIDE WORK SUB TOTAL AMOUNT				
	GRAND TOTAL OF B (PART I + PART II)				

GST Will be charged extra.


इंडियन बैंक



Indian Bank

इलाहाबाद

ALLAHABAD

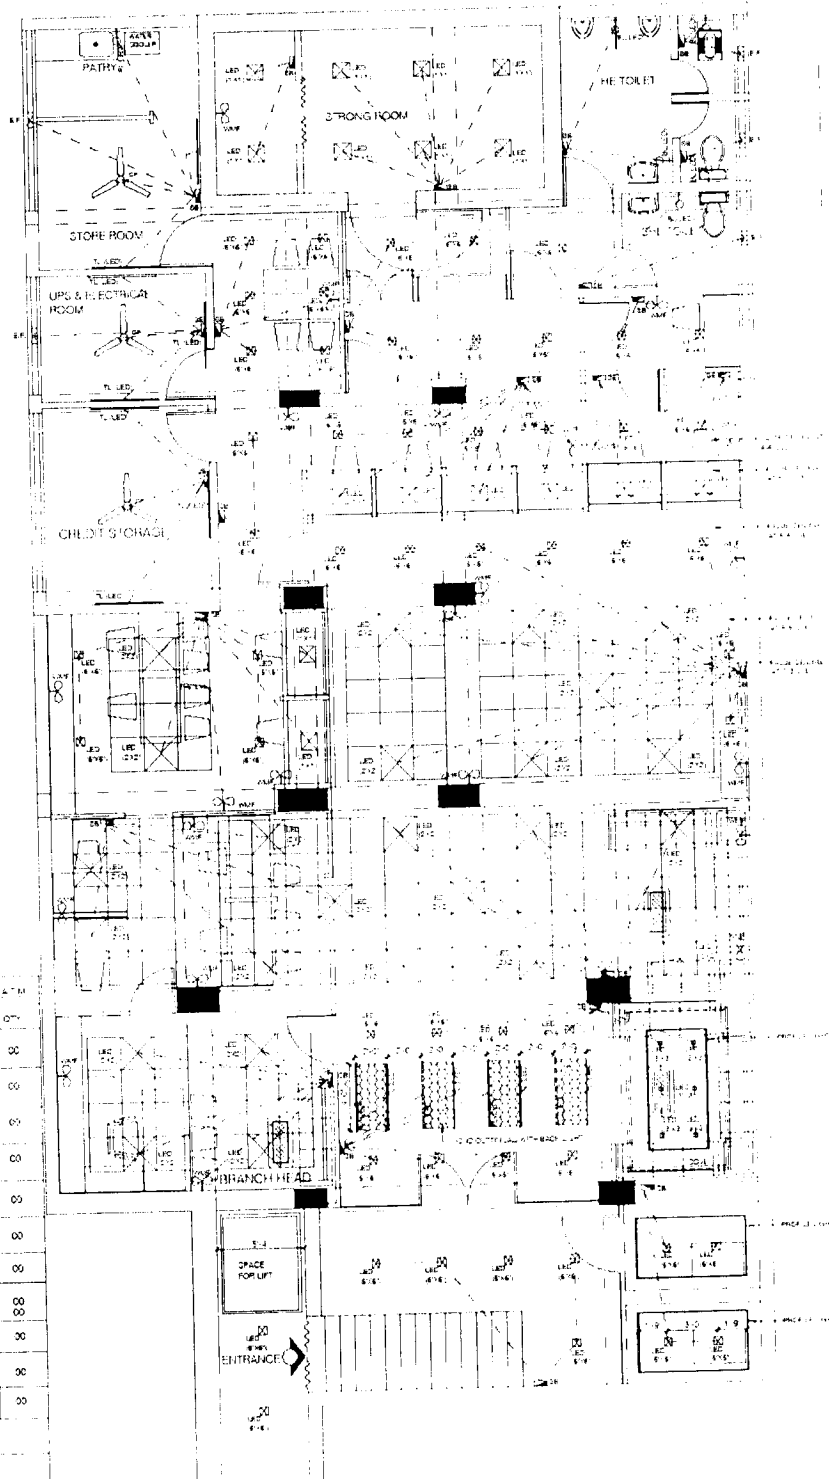

LEGEND			BRANCH	A.T.M.
01	LED	RETRACTABLE	01	01
02	LED	SQUARE LIGHT 2'x2'	02	02
03	LED	SQUARE LIGHT 1'x1'	03	03
04	LED	SQUARE LIGHT 1'x1'	04	04
05	LED	SQUARE LIGHT 2'x2'	05	05
06	LED	TUBE LIGHT (LED)	06	06
07	LED	BRACKET LIGHT (LED)	07	07
08	WALL	WALL MOUNTED FAN	08	08
09	CEILING	CEILING FAN 800 MM DIA	09	09
10	EXHAUST	EXHAUST FAN	10	10
11	CALL	CALL BELL	11	11
12	SWITCH	SWITCH BOARD & 5 AMP SWITCH & COCK	12	12
13	DOWN	DOWN LIGHT	13	13
14	COVER	COVER LIGHT	14	14

PROJECT: PROPOSED FURNISHING & ELECTRICAL WORKS
 BANK: INDIAN BANK
 BRANCH: LUCKNOW
 REGION: LUCKNOW

DRAWING TITLE: ELECTRICAL LAYOUT PLAN (G.F. L.N.G.)
 DATE: SEP 2025
 SCALE: 1/8" = 1'-0"

ARCHITECTS: POINT ARCHITECTS PVT. LTD.
 GROUND FLOOR, ROYAL COURT
 WAT, BAHADUR NAGAR
 LUCKNOW
 PHONE: 98765 43210